
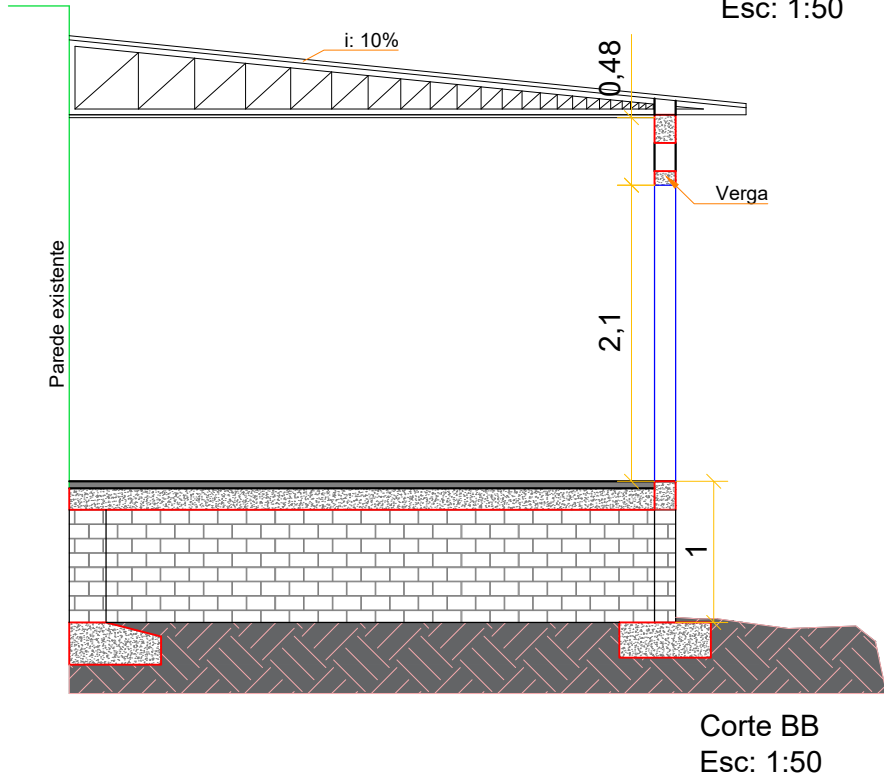
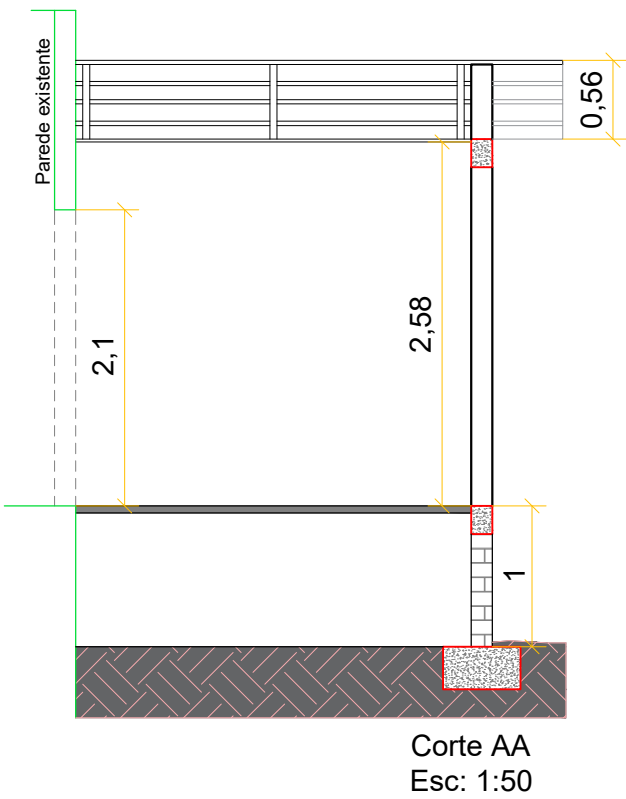
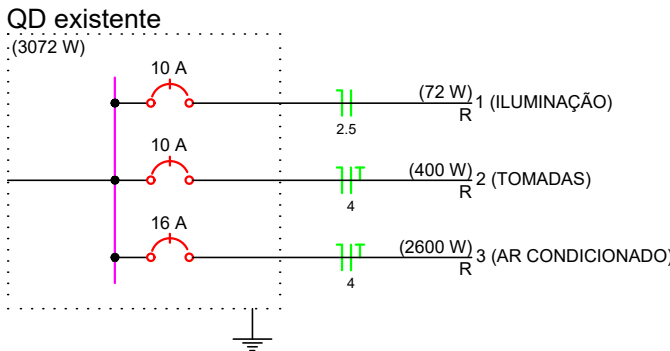
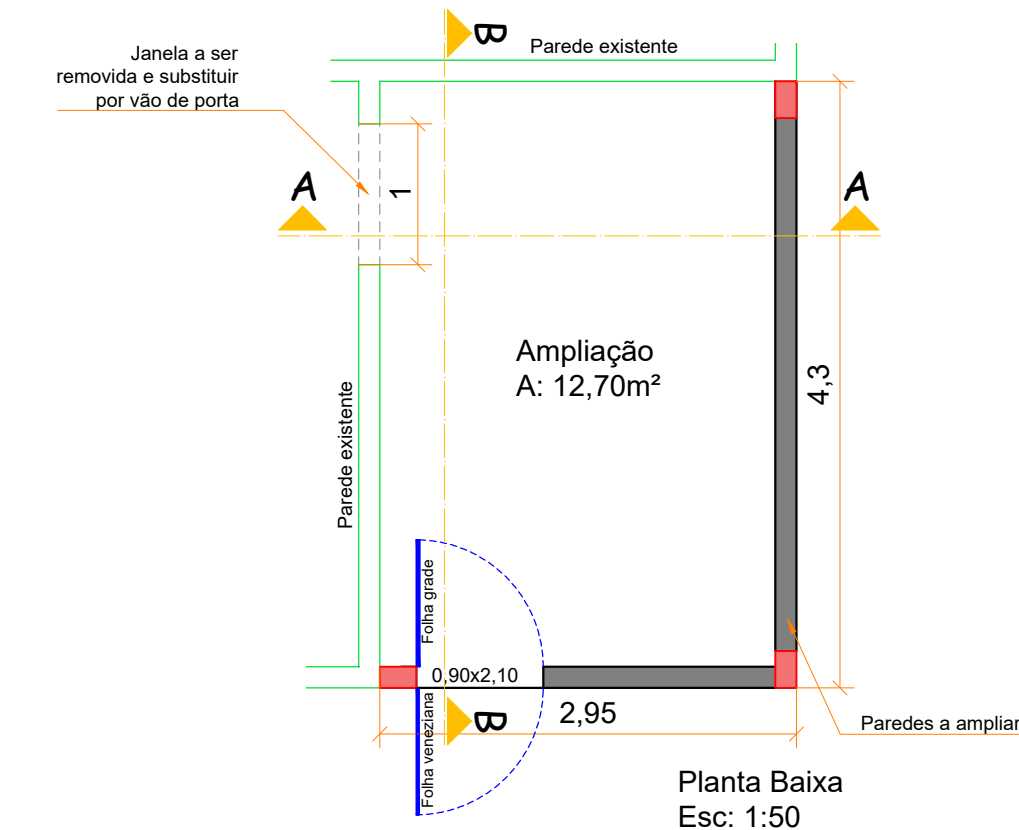


Quadro de Cargas																	
Circuito	Descrição	Esquema	Método de inst.	V (V)	Iluminação (W)		Tomadas (W)		Pot. total. (VA)	Pot. total. (W)	Fases	Pot. - R (W)	Pot. - S (W)	Pot. - T (W)	FCT	FCA	In' (A)
					36	100	2600										
1	ILUMINAÇÃO	F+N	B1	220 V	2				95	72	R	72			1.00	0.70	0.6
	a				2				95	72	R	72				0.70	0.6
2	TOMADAS	F+N+T	B1	220 V		4			500	400	R	400			1.00	0.70	3.2
3	AR CONDICIONADO	OF+N+T	B1	220 V			1		2889	2600	R	2600			1.00	0.70	18.8
TOTAL					2	4	1		3484	3072	R	3072	0	0			

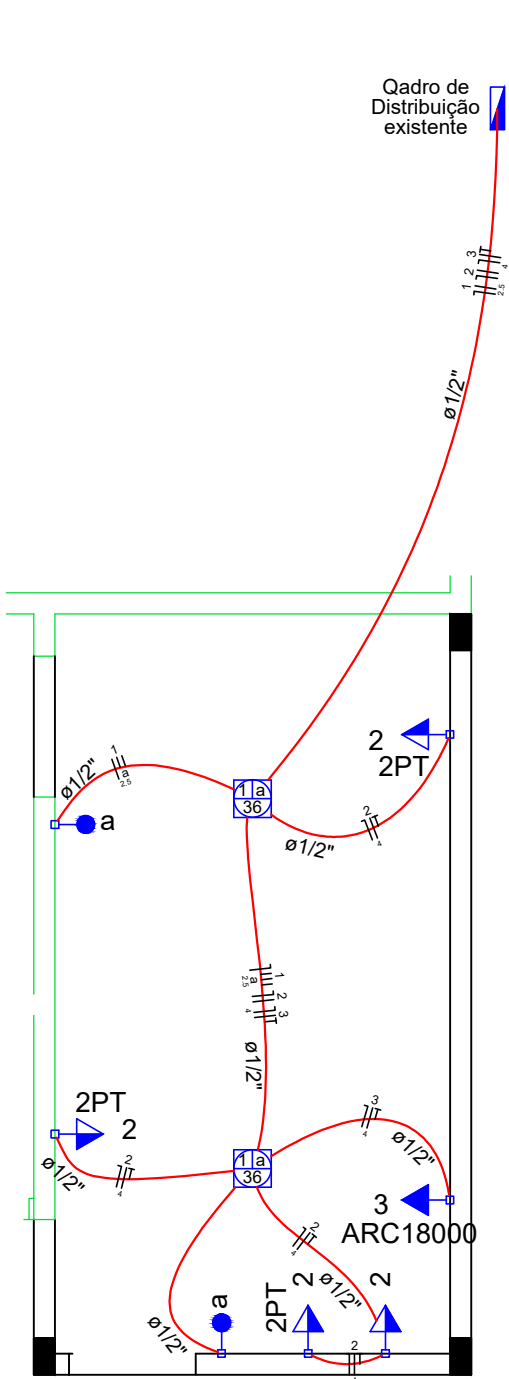

PREFEITURA MUNICIPAL DE ROQUE GONZALES			
AMPLIAÇÃO DA FARMÁCIA BÁSICA			
Rua Senador Pinheiro Machado, nº 22 - Centro - ROQUE GONZALES/RS			
PLANTA BAIXA, CORTES e PROJETO ELÉTRICO			PRANCHA:
RESPONSÁVEL TÉCNICO:	PREFEITO MUNICIPAL:	MÊS/ANO:	01
Magda Luisa Goldschmidt Engª. Civil - CREA RS 231.145	Fernando Mattes Machry	JAN / 2026	
		ESCALA:	
		Indicada	